

OUTPUTS: L Vp Vff


L: Invalid Op status light (0=off, 1=on)

Vp: Pressure valve (0 = off, 1 = on)

Vff: Forward flow valve (0 = off, 1 = on)

Inputs

A pump status
 B pressure (S'R, latch state)
 C forward flow (S'R, latch state)
 D panic status
 E controller status

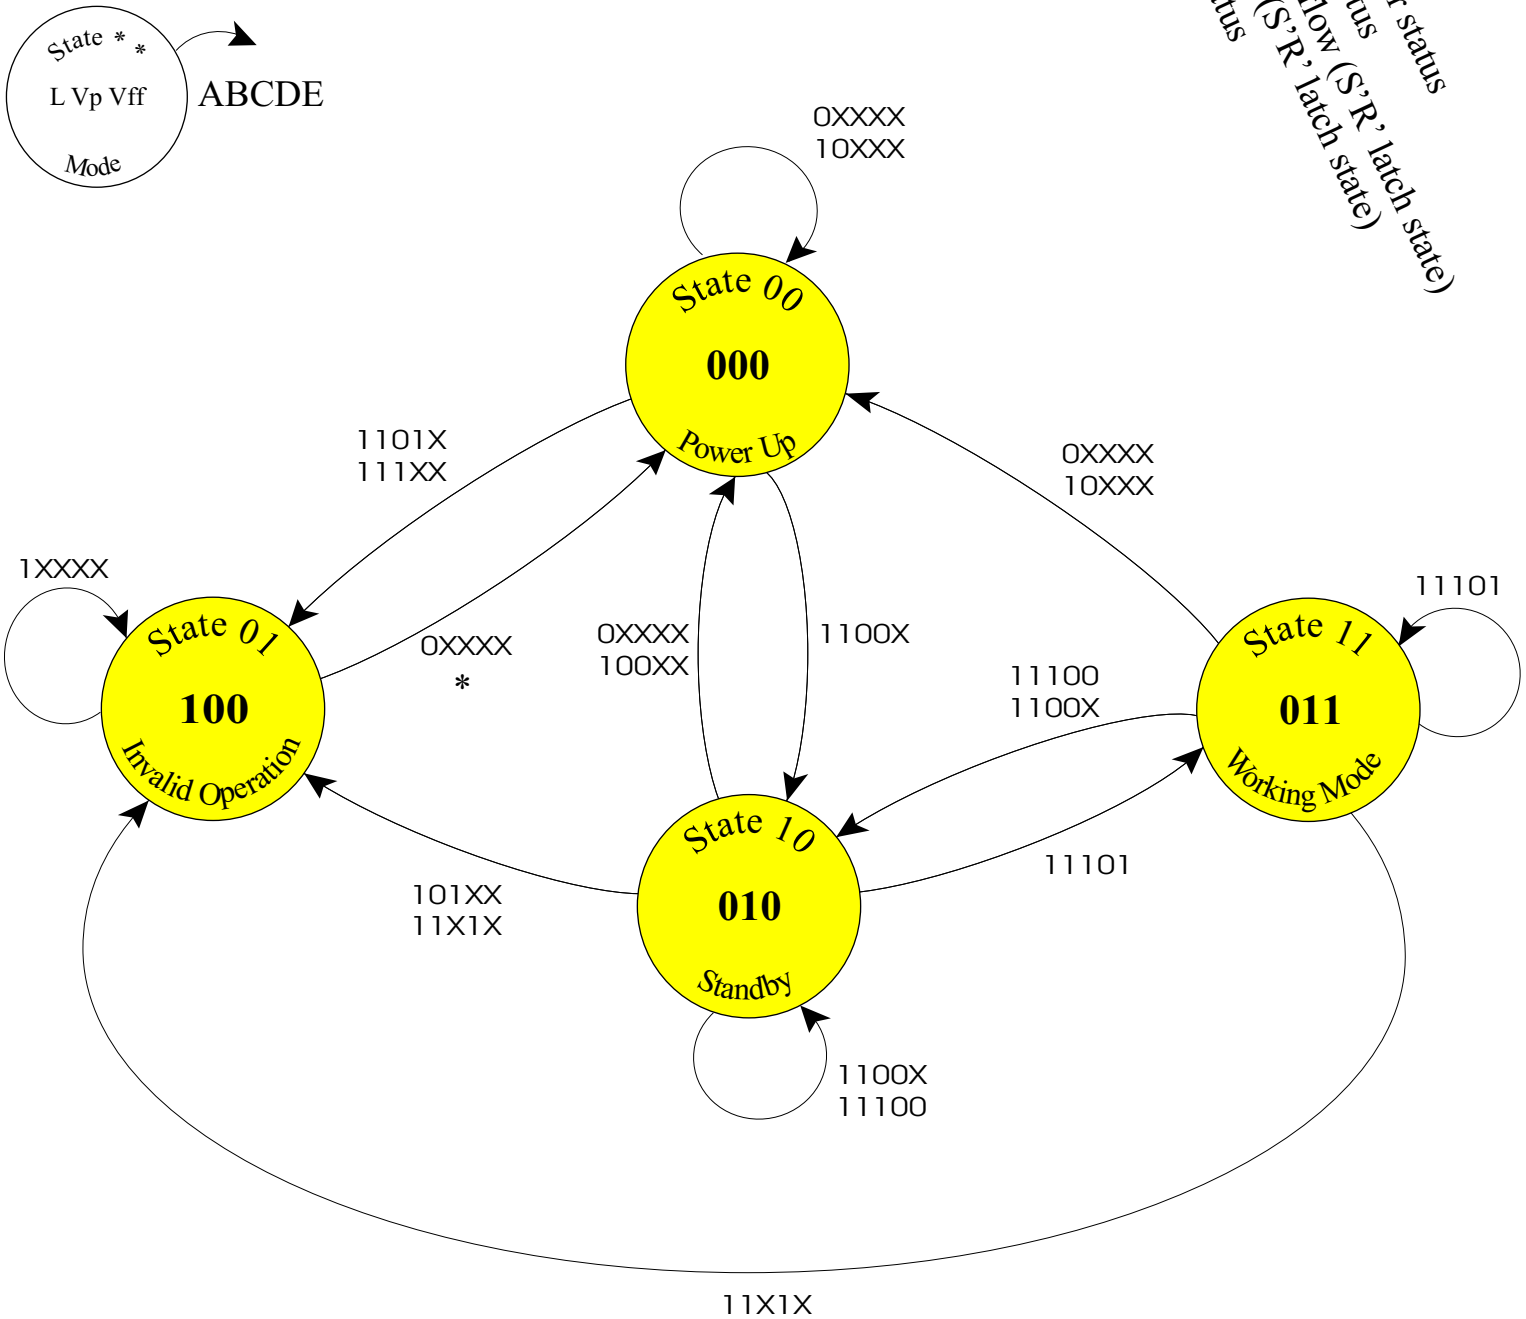

Design by: Ross Wagner

*: From "Invalid Operation" it is possible to reset the machine to "power up" mode by simultaneously depressing both pressure and forward-flow *off* buttons.